


 HOLLYLAND (CHINA) ELECTRONICS TECHNOLOGY CORPORATION LIMITED	PRODUCT SPECIFICATION	ISSUED DATE: 2010/1/12 REV. NO.: A00 DOC. NO.: HLD-PSI-508 PAGE : Page 1 of 5
	HBE RoHS SERIES	

制定 PREPARED BY		审核 CHECKED BY		批准 APPROVED BY	
-------------------	---	------------------	---	-------------------	---

1. 适用范围/ SCOPE

本规格书适用于本公司生产的 HBE RoHS series HOLLY® 商标的螺栓连接型熔断体。

This specification defines the technical requirements of fuse-links with bolted connections type HBE gR series with HOLLY® brand.

产品部件号为: 型号 额定电流
 Construction of part no: type rated current
 例如 For Example: HBE 100

产品部件号 PART NUMBER

目录编号 Part No.	额定电流 Rated Current	额定电压 Rated Voltage	目录编号 Part No.	额定电流 Rated Current	额定电压 Rated Voltage
HBE35	3 5 A	1000V AC 750V DC	HBE225	2 2 5 A	1000V AC 750V DC
HBE40	4 0 A		HBE250	2 5 0 A	
HBE45	4 5 A		HBE275	2 7 5 A	
HBE50	5 0 A		HBE300	3 0 0 A	
HBE60	6 0 A		HBE315	3 1 5 A	
HBE70	7 0 A		HBE350	3 5 0 A	
HBE80	8 0 A		HBE400	4 0 0 A	
HBE90	9 0 A		HBE500	5 0 0 A	
HBE100	1 0 0 A		HBE600	6 0 0 A	
HBE125	1 2 5 A		HBE650	6 5 0 A	
HBE150	1 5 0 A		HBE700	7 0 0 A	
HBE175	1 7 5 A		HBE800	8 0 0 A	
HBE200	2 0 0 A		/	/	

2. 相关标准及认证情况 APPLICABLE STANDARDS & APPROVED DETAILS


2.1 HBE RoHS 系列产品适用的相关标准是 IEC 60269, GB 13539.


Applicable standards for HBE RoHS series are IEC 60269 and GB 13539.

3. 公司地址 ADDRESS

中国福建省厦门市湖里区枋湖路 9-19 号
 NO. 9-19, FANGHU ROAD, HULI, XIAMEN, FUJIAN, CHINA.

4. 构造图 CONSTRUCTION FIG. & DIMENSION

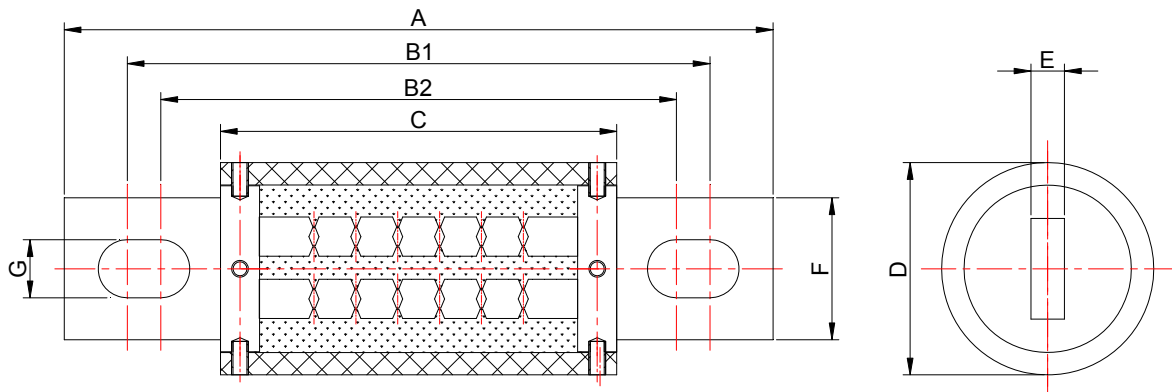

 HOLLYLAND (CHINA) ELECTRONICS TECHNOLOGY CORPORATION LIMITED	PRODUCT SPECIFICATION	ISSUED DATE: REV. NO.: DOC. NO.: PAGE :	2010/1/12 A00 HLD-PSI-508 Page 2 of 5
	HBE RoHS SERIES		

额定电流 Current Rating A	尺寸 Dimensions(mm)							
	A	B1	B2	C	D	E	F	G
35A-60A	125	108	106	87	25.4	3.4	19.2	8.2
65A-100A	125	108	106	87	31	4.8	24.7	8.2
110A-200A	143	120.4	108.4	87	38	6.4	25.4	10.4
225A-400A	143	120.4	106.4	87	50.8	6.4	38	10.4
450A-800A	183	152	120	87	63.5	9.5	50.8	14.3

4.1 原材料规格 MATERIAL

品名 PART	材料 MATERIAL	备注 REMARK
触刀 Contact	黄铜 Brass	
管体 Tube	三聚氰胺玻璃布管 Melamine glass fabric tube	
可熔体 Fusible Element	金属片 Metal Sheet	
石英砂 Quartz Sand	二氧化硅 Silicon Dioxide	
销 Dowel	钢 Steel	
螺钉 Bolt	钢 Steel	

5. 电气特性 ELECTRICAL PERFORMANCES

5.1 测试条件 TEST CONDITIONS

全部测试条件都应在环境温度 $20^{\circ}\text{C}\pm 5^{\circ}\text{C}$ 条件下进行。

All electrical tests are conducted at a ambient temperature of $20\pm 5^{\circ}\text{C}$.

5.2 负载能力测试 CURRENT-CARRYING CAPACITY TEST

当熔断体通以额定电流，持续4小时以上，电路不应断开，熔断体不被电流熔断，管体不破裂。

A fuse-link shall carry rated current for four hour or more, and the circuit shall not be opened. While the fuse is carrying this current, no open circuit, melt fusible element, and ruptured tube shall occur in any manner during this test.

5.3 分断能力 BREAKING CAPACITY

熔断体的分断能力应能达到下表规定的分断能力要求。熔断器分断电路后，熔断体及其部件可以改变颜色或者裂缝，但熔断体从载熔件或试验架上取出之前须保持为一整体、且其两端的绝缘电阻不小于 $0.1\text{M}\Omega$ 。

The breaking capacity should reach the breaking current rating given in the following table. After this test, the fuse-links or their parts may have changed their colour or may show cracks, provided that the fuse-link remains in one piece before its removal from the fuse-carrier or test rig, and the insulation resistance of both two terminals shall be not less than $0.1\text{M}\Omega$.

额定电压/RATED VOLTAGE	分断电流/ BREAKING CURRENT
1000V AC	100kA
750V DC	50kA



**HOLLYLAND (CHINA) ELECTRONICS
TECHNOLOGY CORPORATION LIMITED**

**PRODUCT
SPECIFICATION**

HBE RoHS SERIES

ISSUED DATE:

REV. NO.:

DOC. NO.:

PAGE :


2010/1/12

A00


HLD-PSI-508


Page 3 of 5

5.4 平均I-T特性曲线图(仅供参考) THE AVERAGE I-T CHARACTERISTICS CURVE (FOR REFERENCE ONLY)

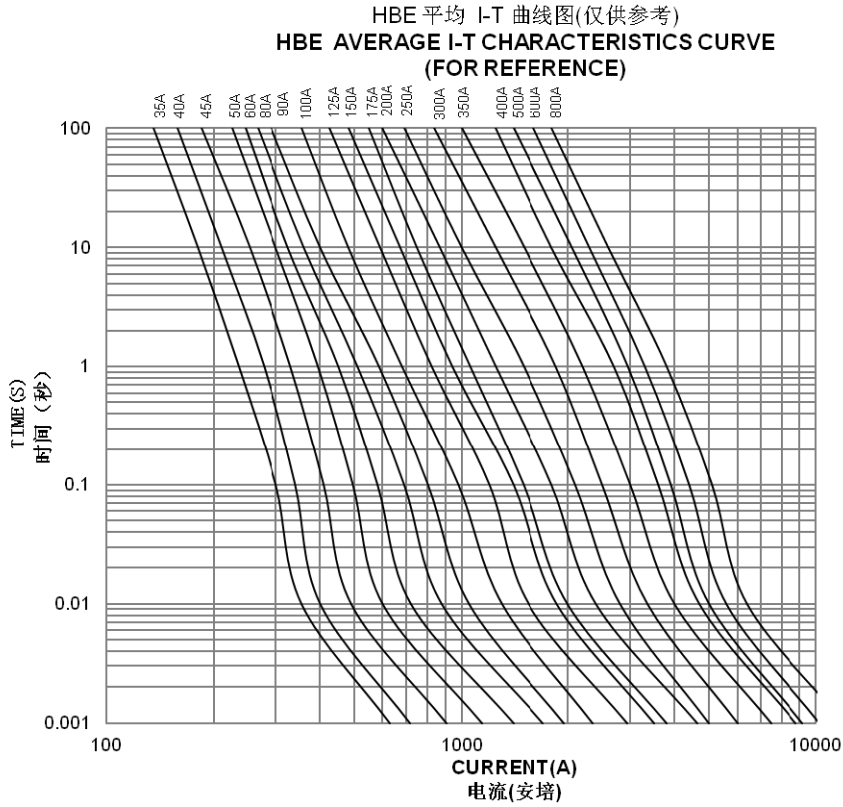


5.5 平均截断电流图(仅供参考) THE AVERAGE CUT-OFF CHARACTERISTICS (FOR REFERENCE ONLY)

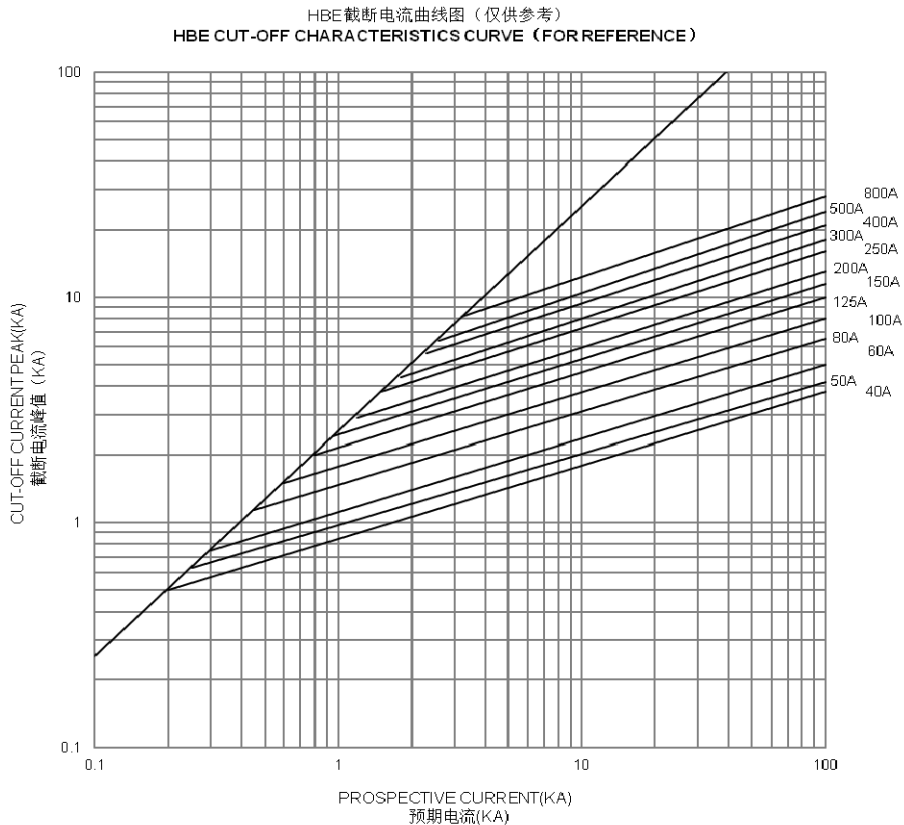

 HOLLYLAND (CHINA) ELECTRONICS TECHNOLOGY CORPORATION LIMITED	PRODUCT SPECIFICATION	ISSUED DATE: REV. NO.: DOC. NO.: PAGE :	2010/1/12 A00 HLD-PSI-508 Page 4 of 5
	HBE RoHS SERIES		

5.6 电流功耗曲线图(仅供参考) :

THE AVERAGE Watts Loss vs. % Rated Current CHARACTERISTICS (FOR REFERENCE ONLY)

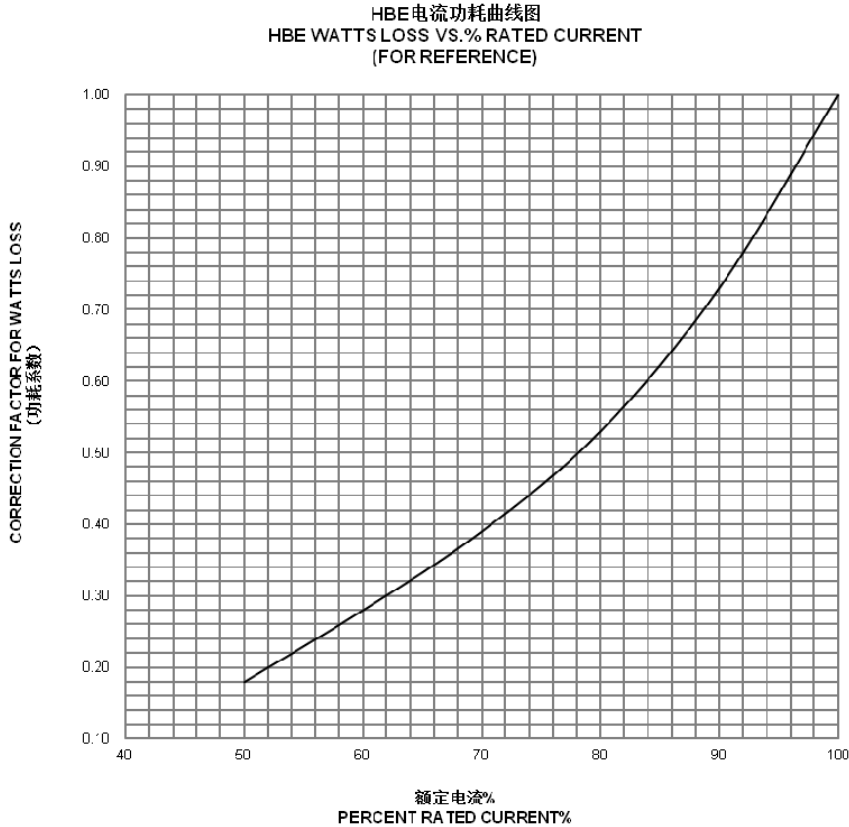

5.7 电阻测试COLD RESISTANCE TEST

环境温度为 $20\pm 5^{\circ}\text{C}$ ，测试电流不大于熔断体额定电流的10%。

Input less than or equal to 10% rated current of fuse-link to fuse for cold resistance test at the ambient temperature of $20\pm 5^{\circ}\text{C}$.

6.产品标志MARKING

6.1 熔断体上的标志应易于看清。

The relevant markings shall be marked on tube of the fuse-link and shall be easily visible.

6.2 每个熔断体应标有下列标记: The symbol for every fuse shall be as prescribed below:


6.2.1 商标Trade mark: HOLLY®

6.2.2 分断范围与使用类别Breaking range and utilization category: aR

6.2.3 额定电流Rated current:

6.2.4 额定电压Rated voltage: 1000V AC 750V DC


6.2.5 型号标识Type mark: HBE

6.2.6 熔断器(5016)和整流器(5186)标志的组合A combination of symbols of a fuse(5016) and rectifier (5186): 

7.包装要求PACKING DETAILS


7.1 标签Label

标签应包括: 型号、额定电压、额定电流、批量号码、RoHS 标志。

 HOLLYLAND (CHINA) ELECTRONICS TECHNOLOGY CORPORATION LIMITED	PRODUCT SPECIFICATION	ISSUED DATE: 2010/1/12 REV. NO.: A00 DOC. NO.: HLD-PSI-508 PAGE : Page 5 of 5
	HBE RoHS SERIES	

The label in the smallest package in which the fuse-links are put shall contain the Type, Rated voltage, Rated current, Lot. No., "RoHS" mark.

例批量号:

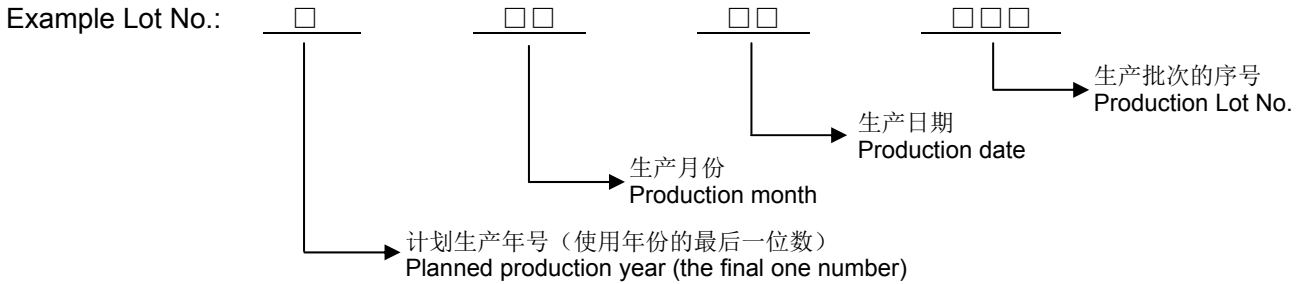

7.2 所有产品的包装应能达到防潮、抗振的作用，以防在运输或贮存过程中产品受潮或损坏。

Packing should meet the requirements of anti-moisture and anti-shaking so that the products will not absorb moisture or be damaged during transportation or storage.